


PLAN
SCALE 3/4"=1'-0"


4A

MECH. NOTES

- (1) DISCONNECT THE COUPLING FROM THE 5/8" OD TUBING, AS SUPPLIED AND SOLDERED SAME TO THE 1/2" OD & 3/4" OD TUBING.
- (2) THE PACKAGED A/C UNIT IS NOW LOCATED AT THE REFRIGERATION SHOP, MAINTENANCE DEPT. OF PWC.
- (3) ALL NEW DUCT SHALL BE GALV. STL. GA#24 AND SHALL BE TREATED WITH WASH PRIMER FORMULA 117 AND PAINTED WHITE TO MATCH CEILING.
- (4) PROVIDE PIPE SUPPORT TO REFRIGERANT LINES EXPOSED OUTSIDE OF BLDG.
- (5) REFRIGERANT LINES SHALL BE HARD DRAWN, TYPE K.

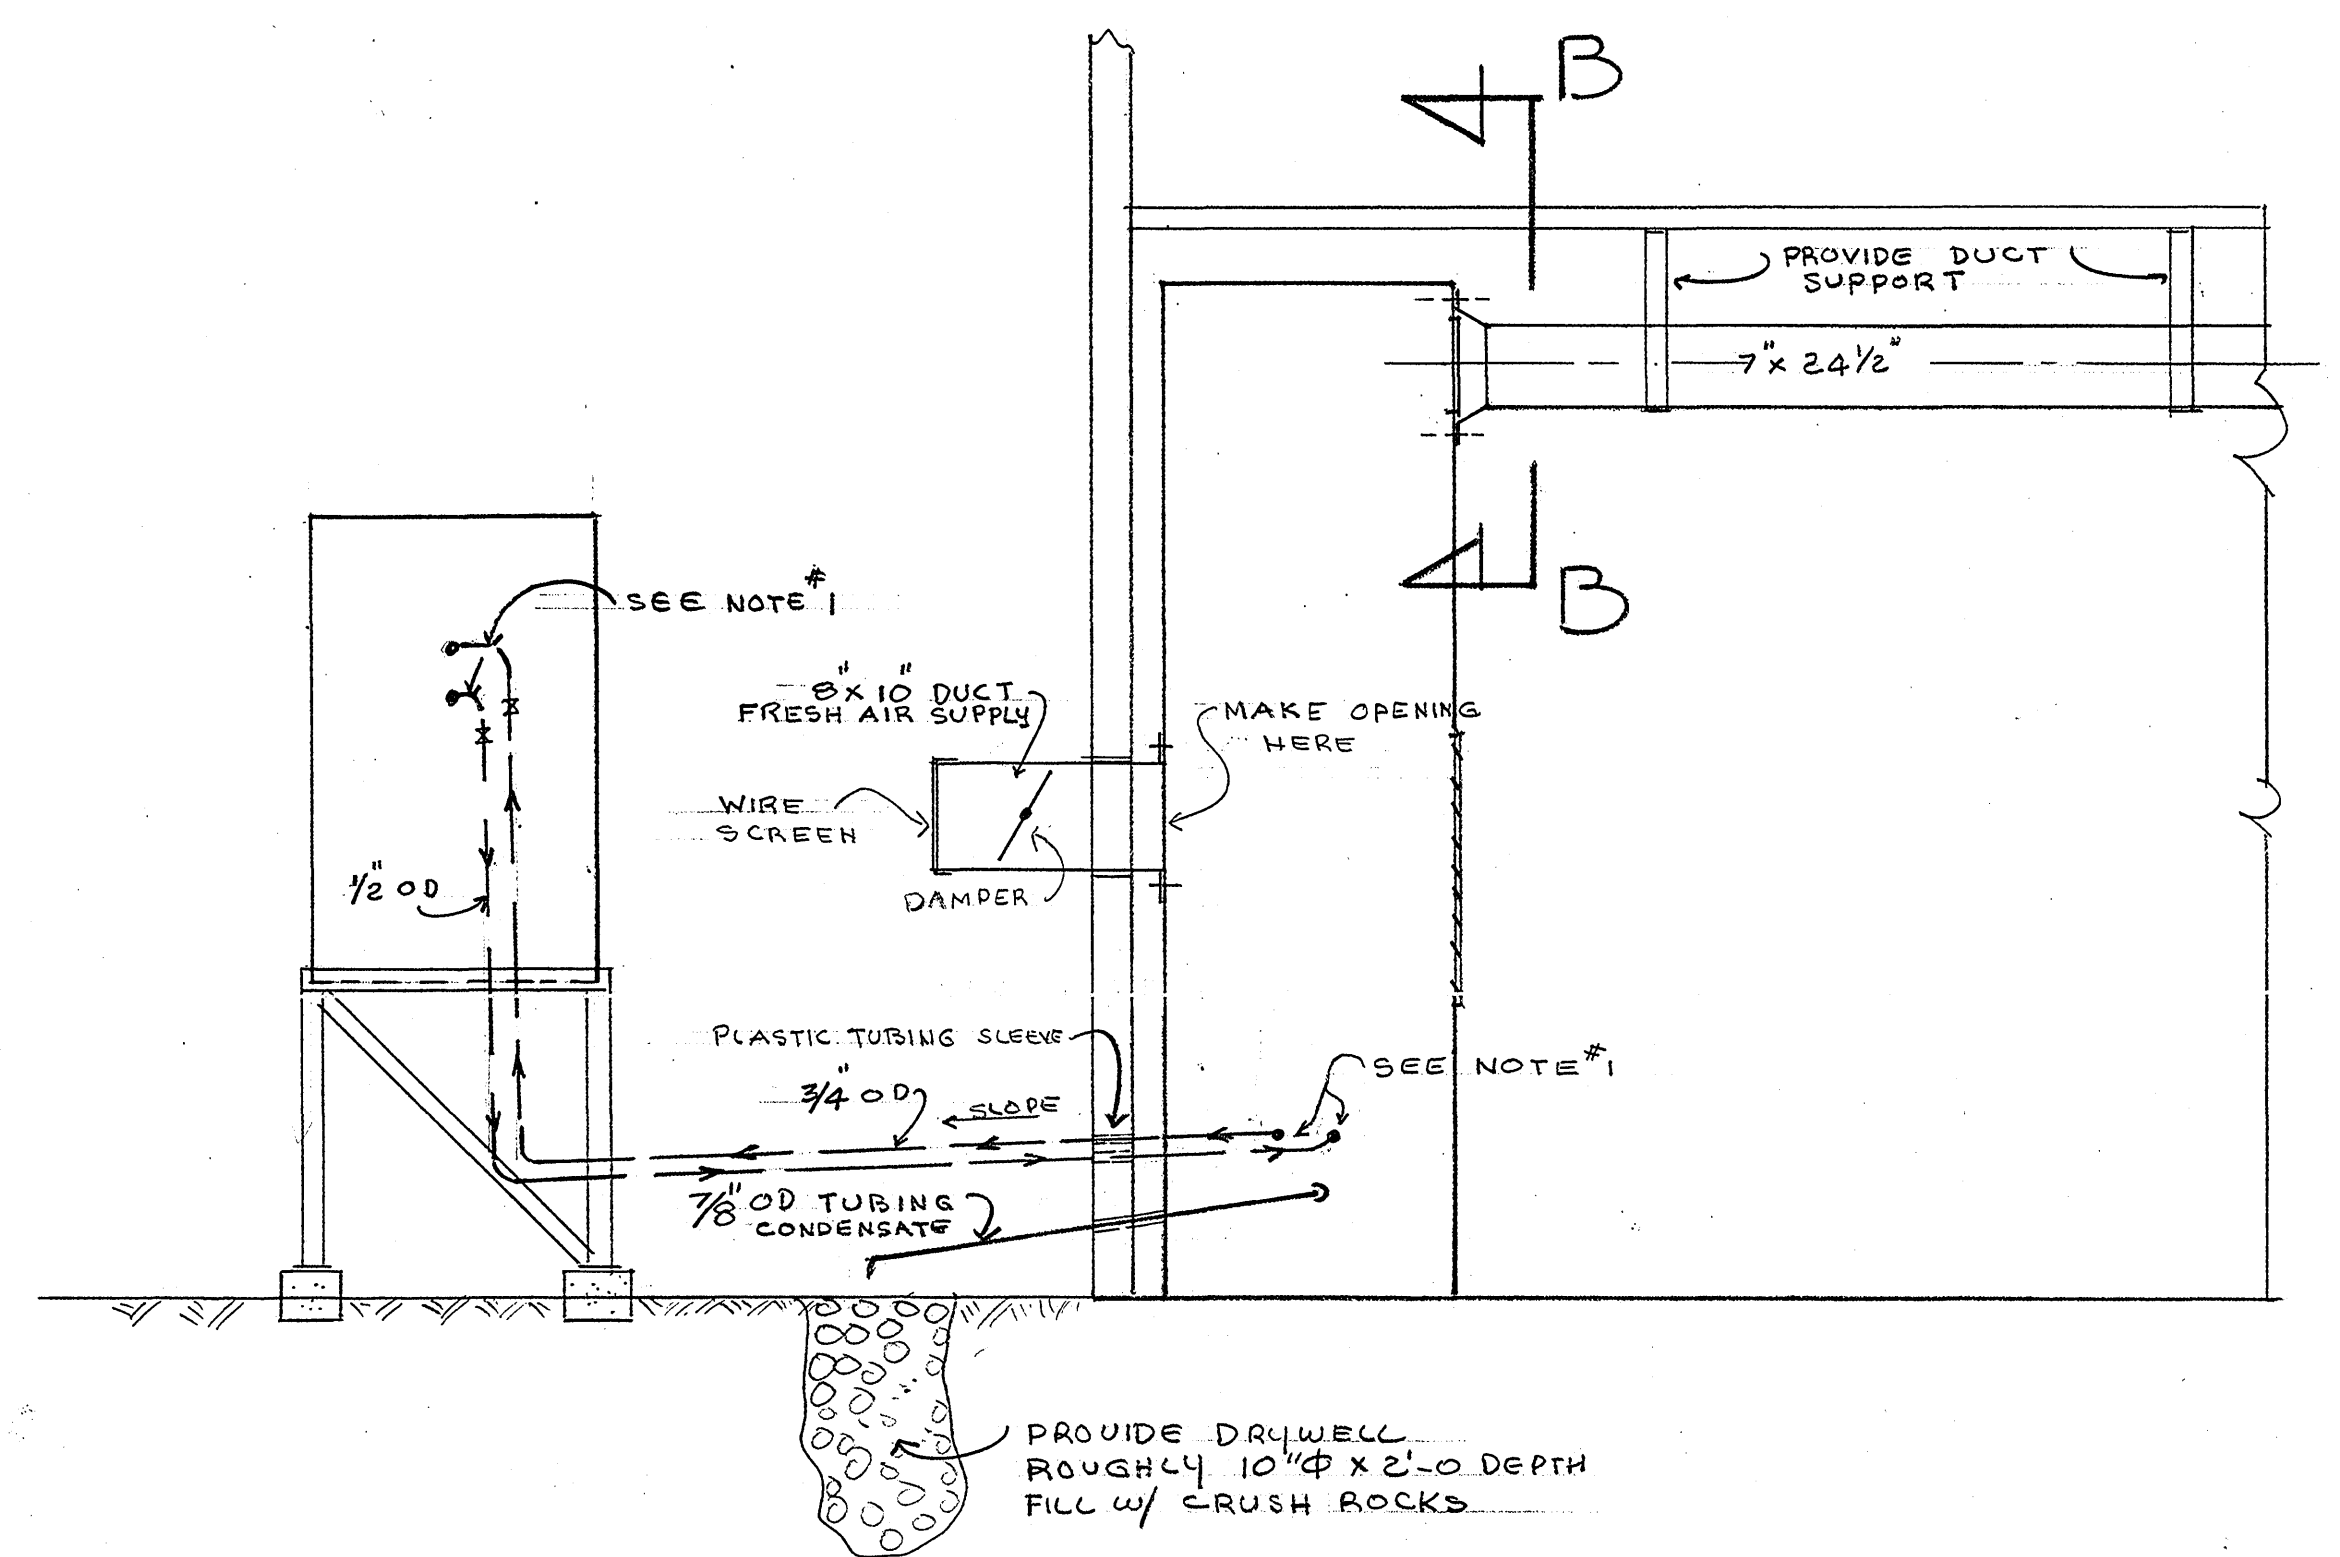

SECT. A-A
SCALE 3/4"=1'-0"

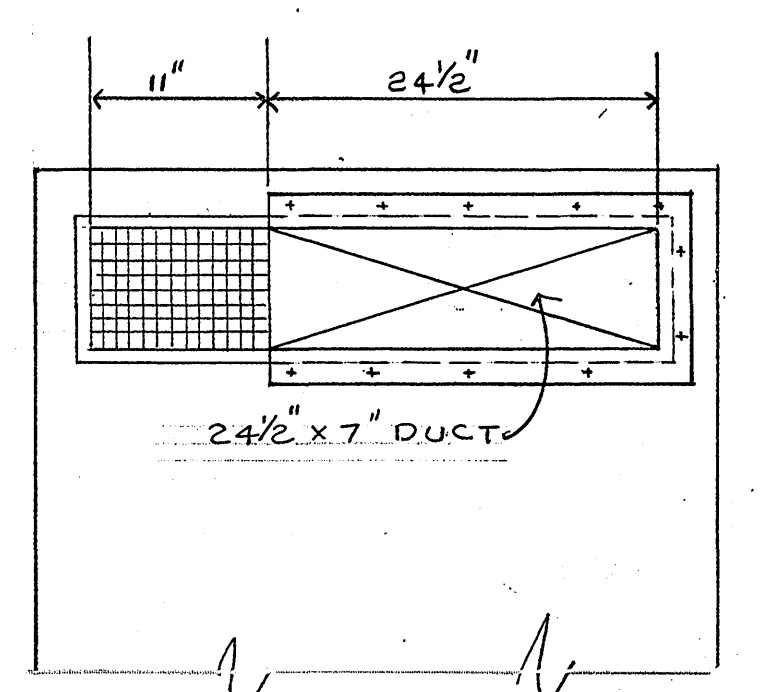

SECT. B-B
SCALE 1"=1'-0"

THIS DWG SUPERSEDES PWC DWG #10,236 FOR AIR-CONDITIONING ONLY

SYMBOL	DESCRIPTION	DATE	APPROVAL
REVISIONS			
PWC DRAWING NO.	DEPARTMENT OF THE NAVY	BUREAU OF YARDS & DOCKS	
11,847	PUBLIC WORKS CENTER, GUAM, M.I.		
DES	PWC, MAINTENANCE DEPT.	GUAM M.I.	
DRWN	A. BAES	OFFICE MACHINE AND INSTRUMENT	
CHK	STACKHOUSE	REPAIR SHOP-AIR-CONDITIONING OF	
DIVDIR		BLDG # 3001	
CORRENGR		MECH. ELECT.	
DEPT HEAD	Bygger	APPROVED	DATE
WR NO.	6117	COMMANDING OFFICER	
SATISFACTORY TO	SCALE AS SHOWN	SPEC	
ACTIVITY	SHEET 1 OF 1	NBY	
SIGNATURE	TITLE	Y&D DRAWING NO	
DATE			