
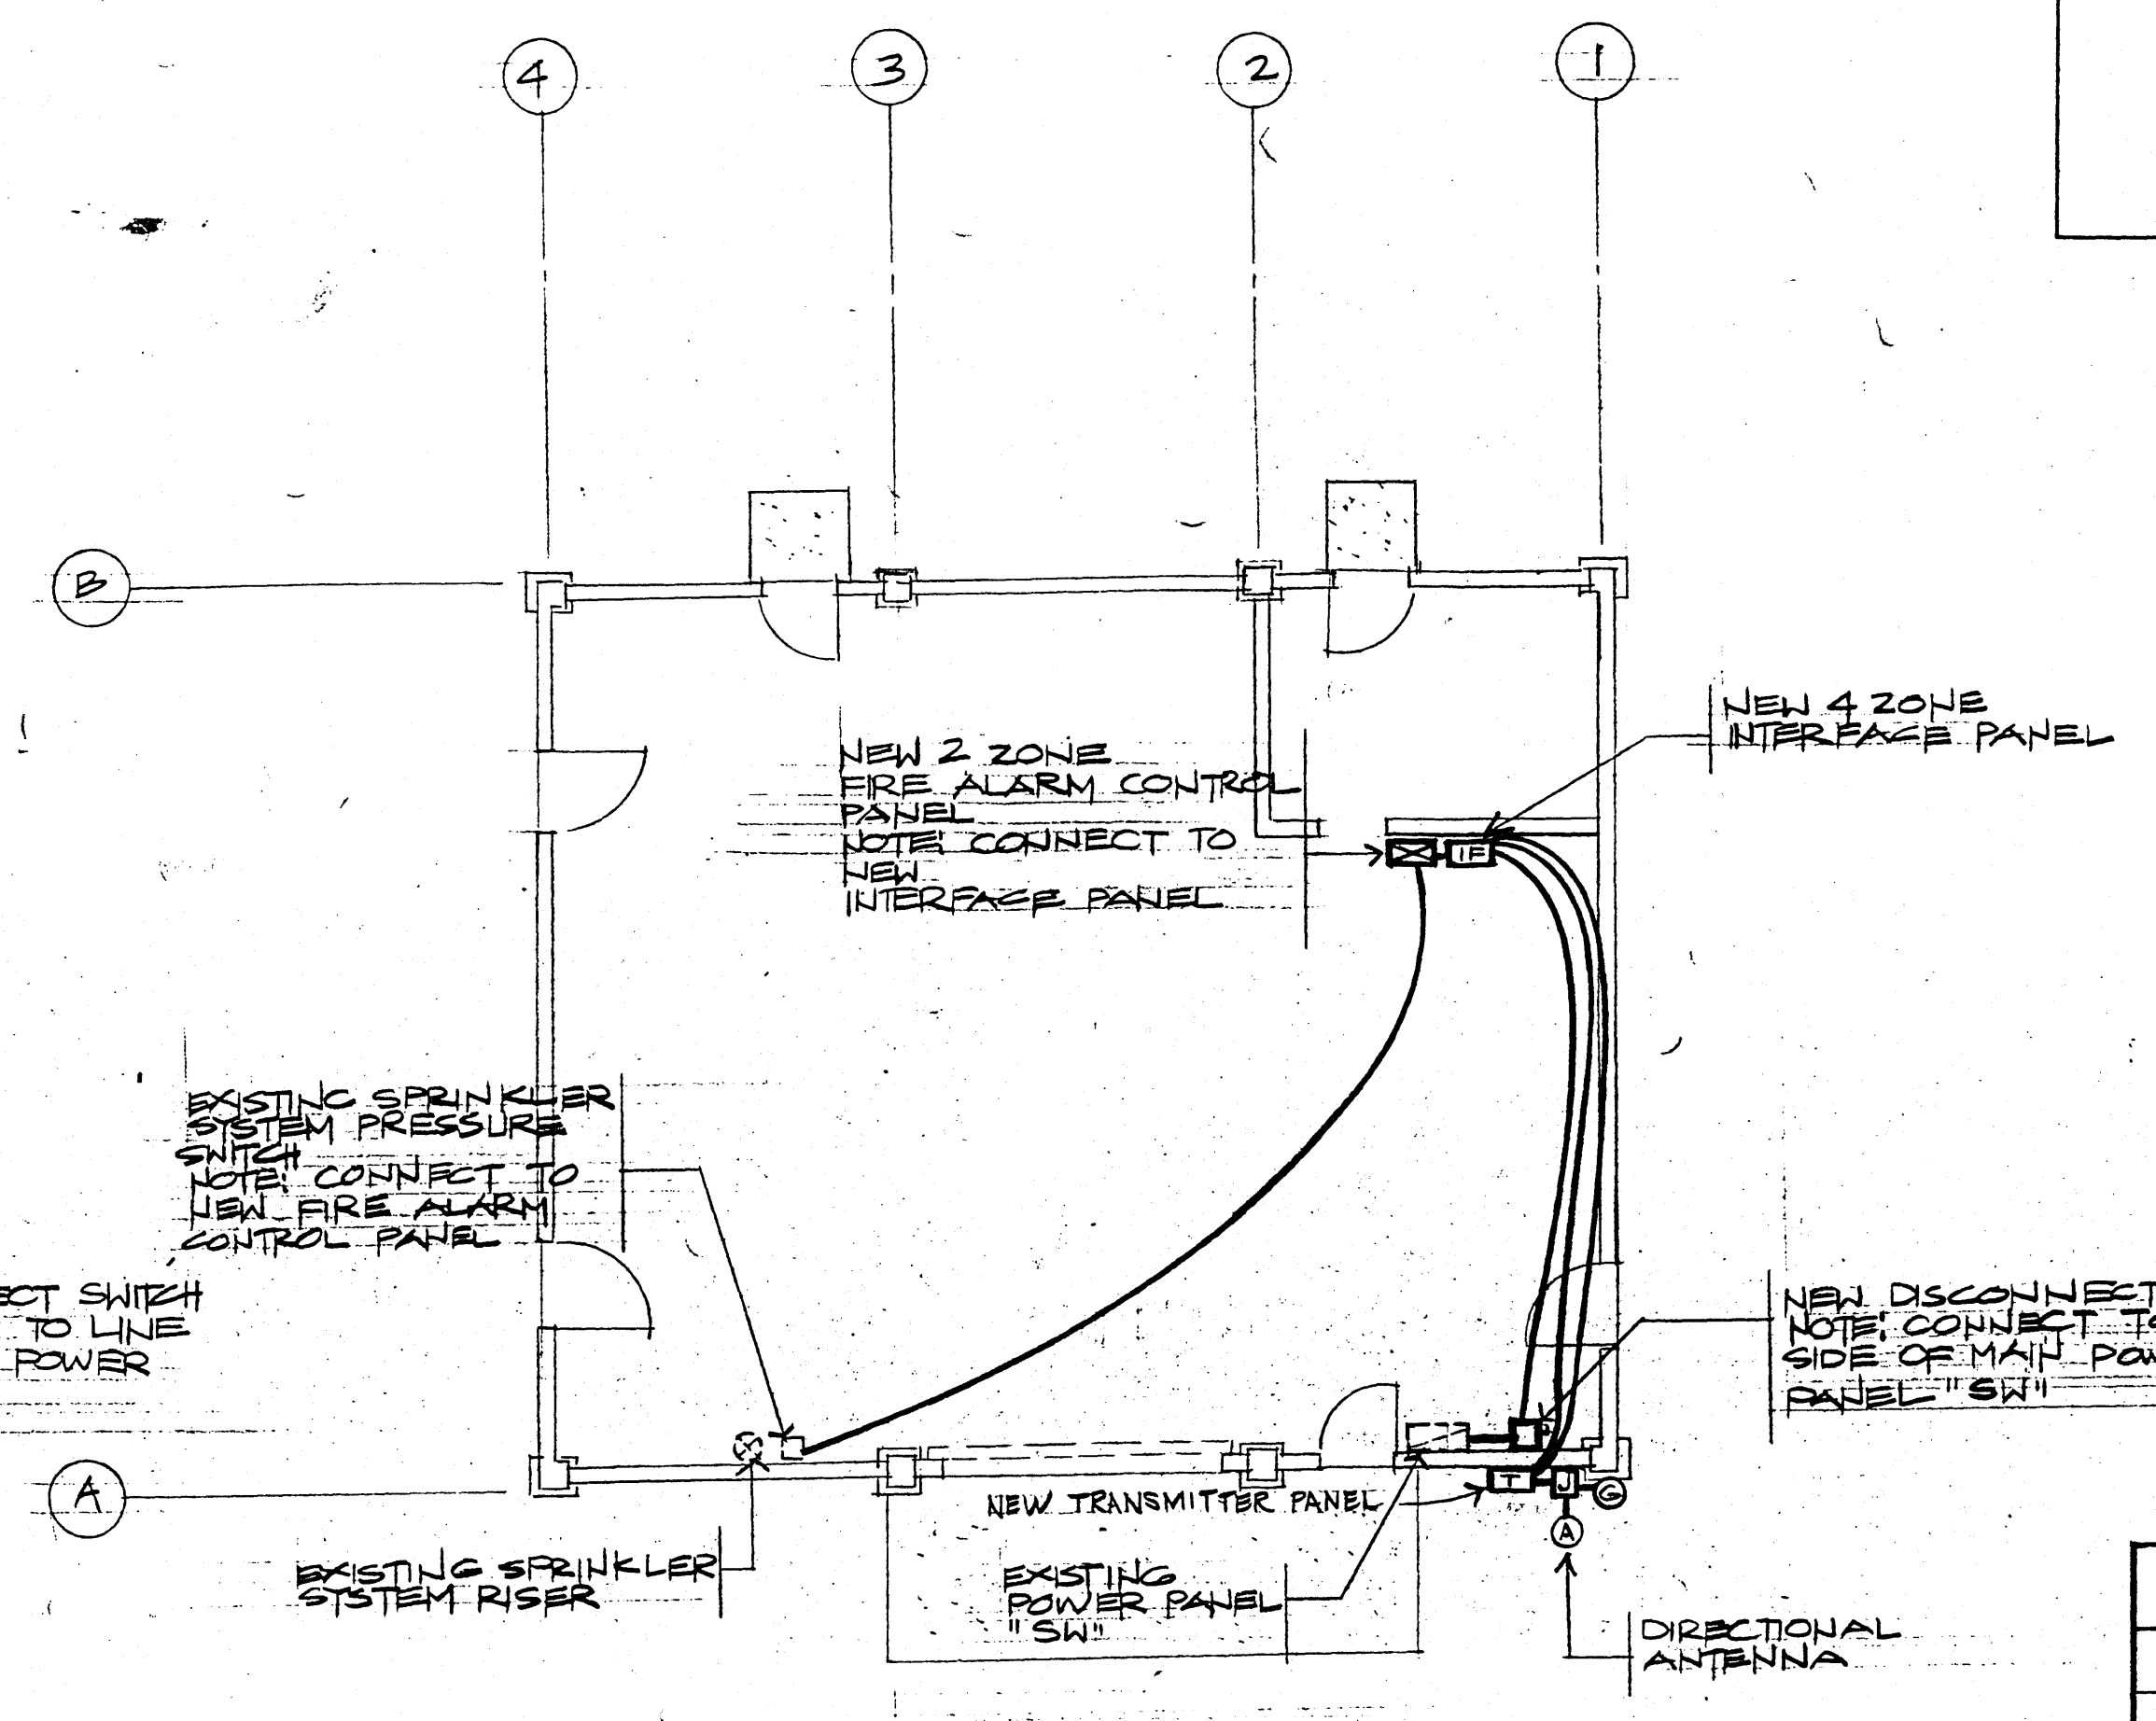


REVISIONS		
SYM	DESCRIPTION	DATE

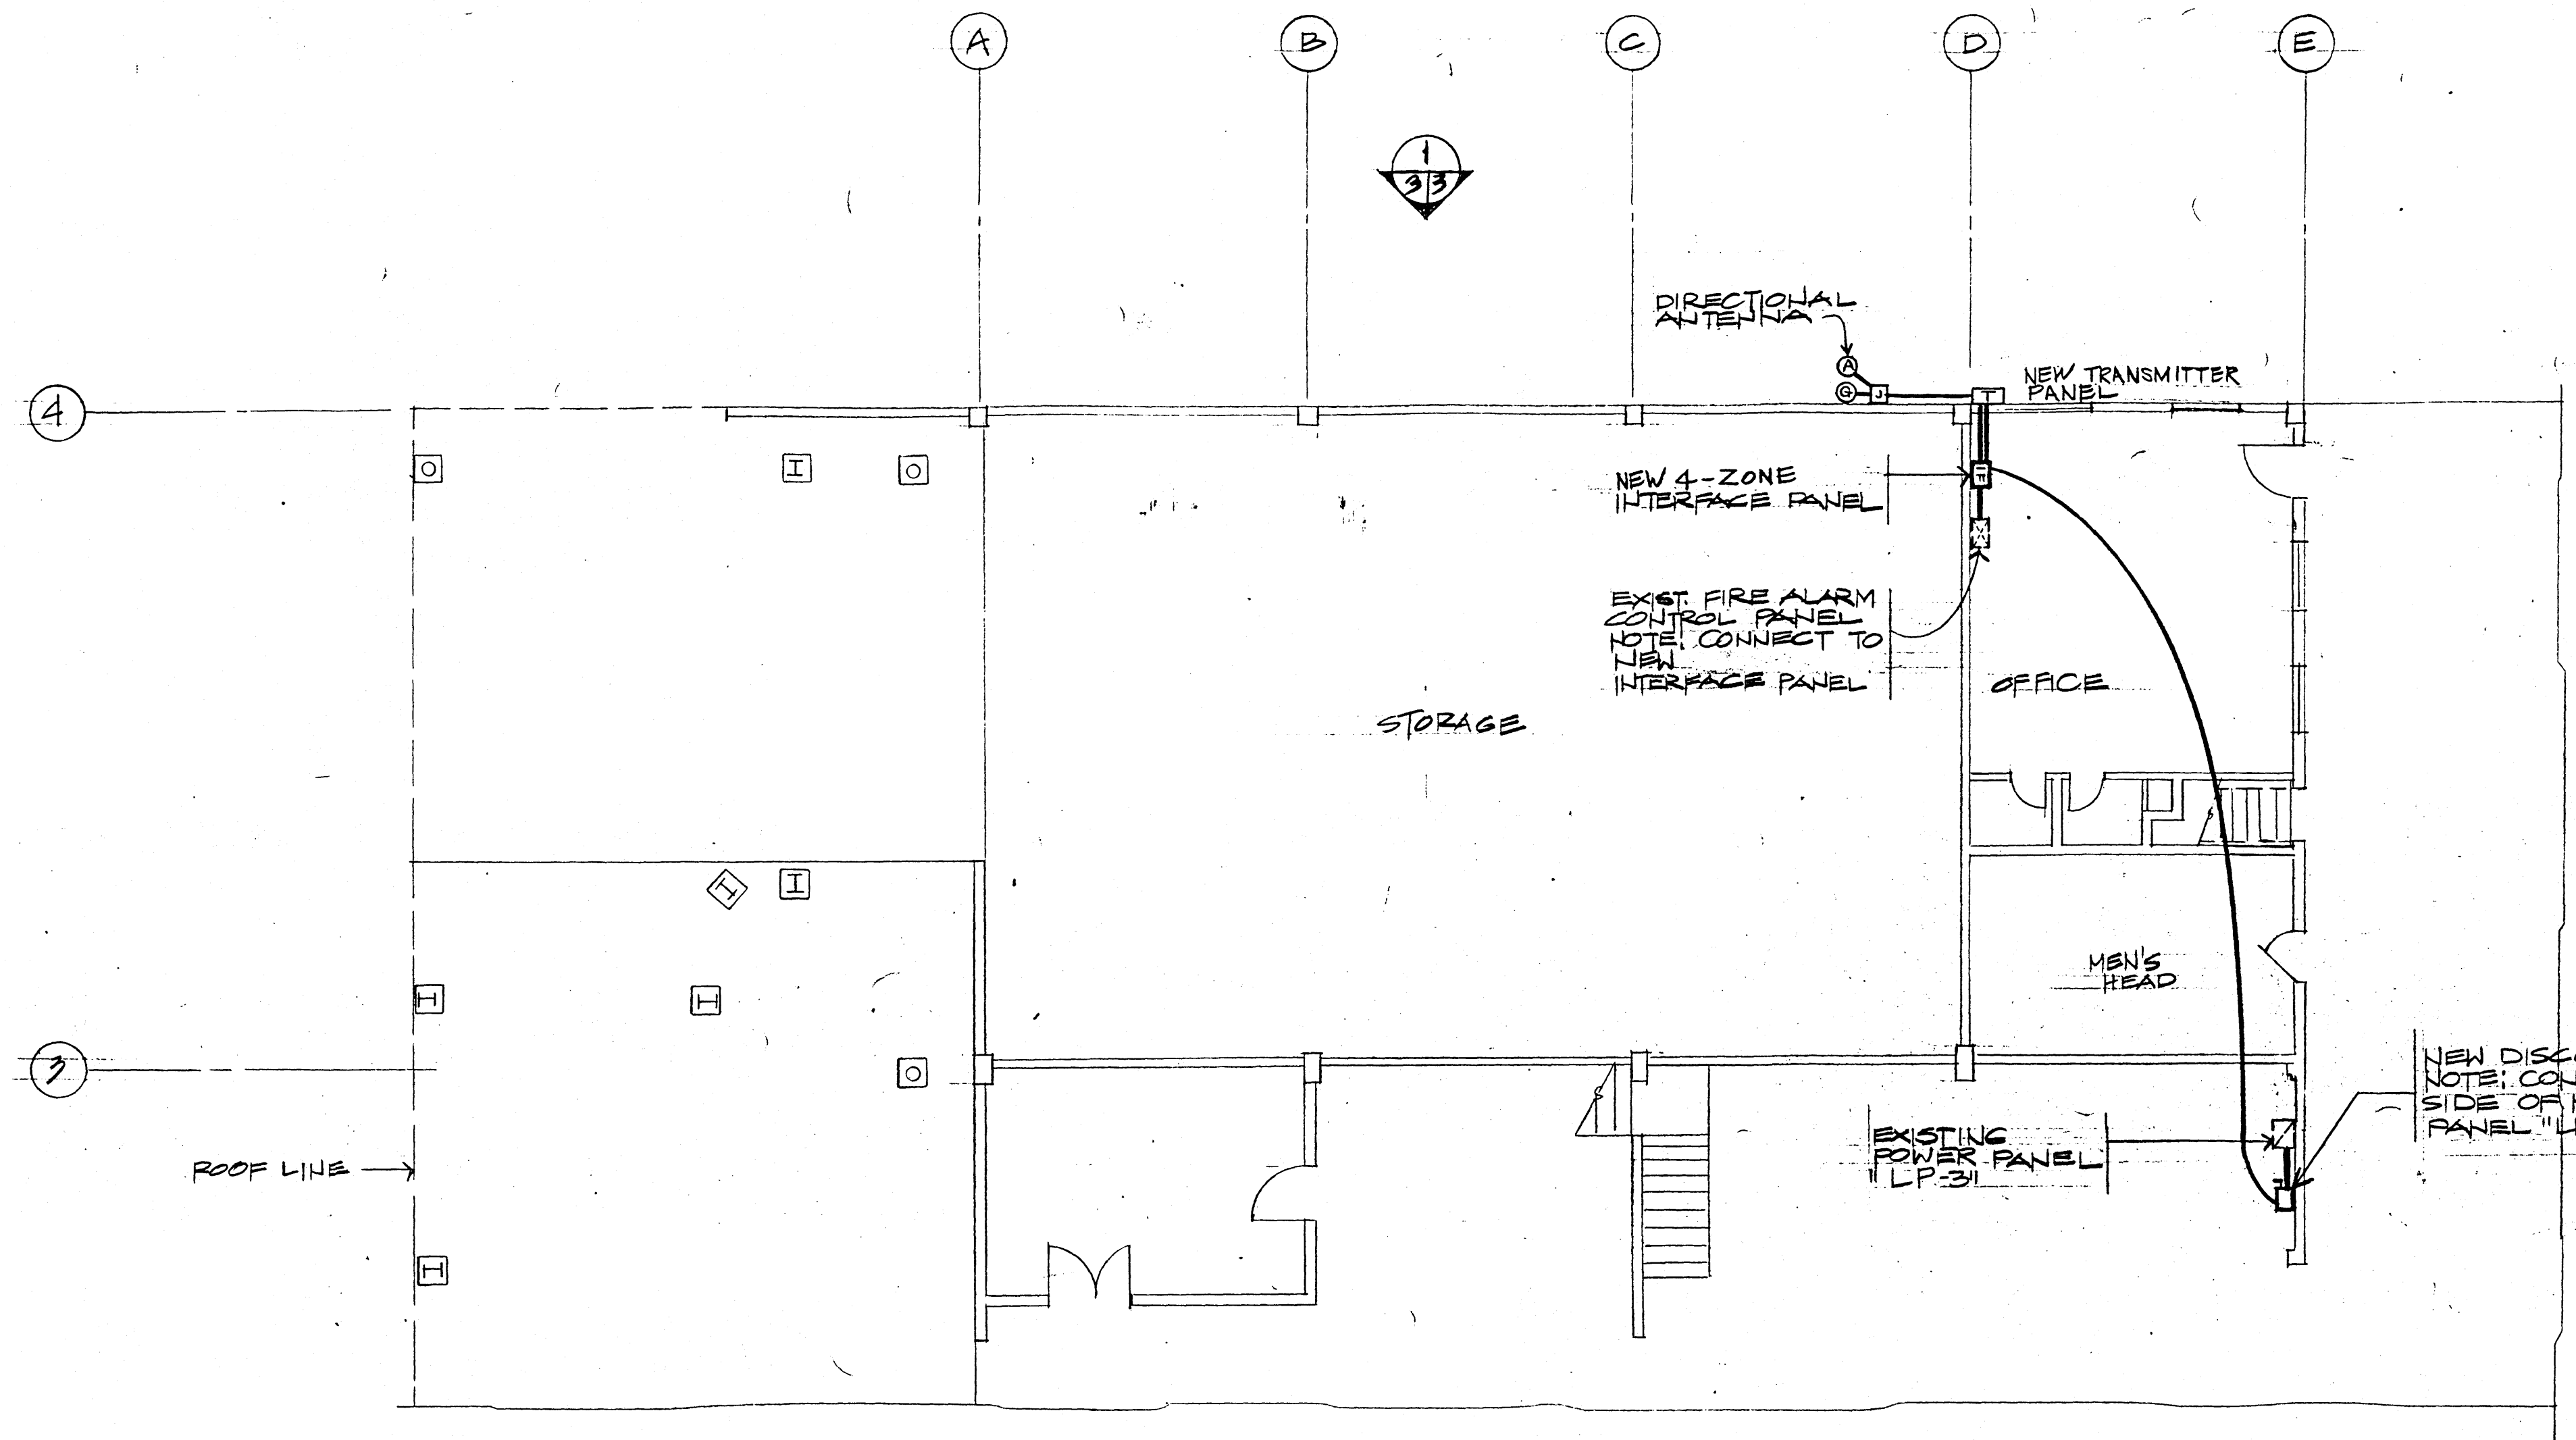

A FIRE ALARM PLAN BLDG. 22
SCALE: 1/8" = 1'-0"

B FIRE ALARM PLAN BLDG. 23
SCALE: 1/8" = 1'-0"


INTERFACE PANEL		
FIREMASTER	DEVICE	LOCATION
1	FACP	BLDG. 22
2		SPARE
3		
4		

FIRE ALARM CONTROL PANEL		
LOCATION	ZONE	DEVICE
BLDG. 23	1	PRESSURE SWITCH
	2	SPARE


INTERFACE PANEL		
FIREMASTER	DEVICE	LOCATION
1	FACP	BLDG. 23
2		SPARE
3		
4		

2 ZONE SCHEDULE IN BLDG. 22
SCALE: 1/8" = 1'-0"

4 ZONE SCHEDULE IN BLDG. 23
SCALE: 1/8" = 1'-0"

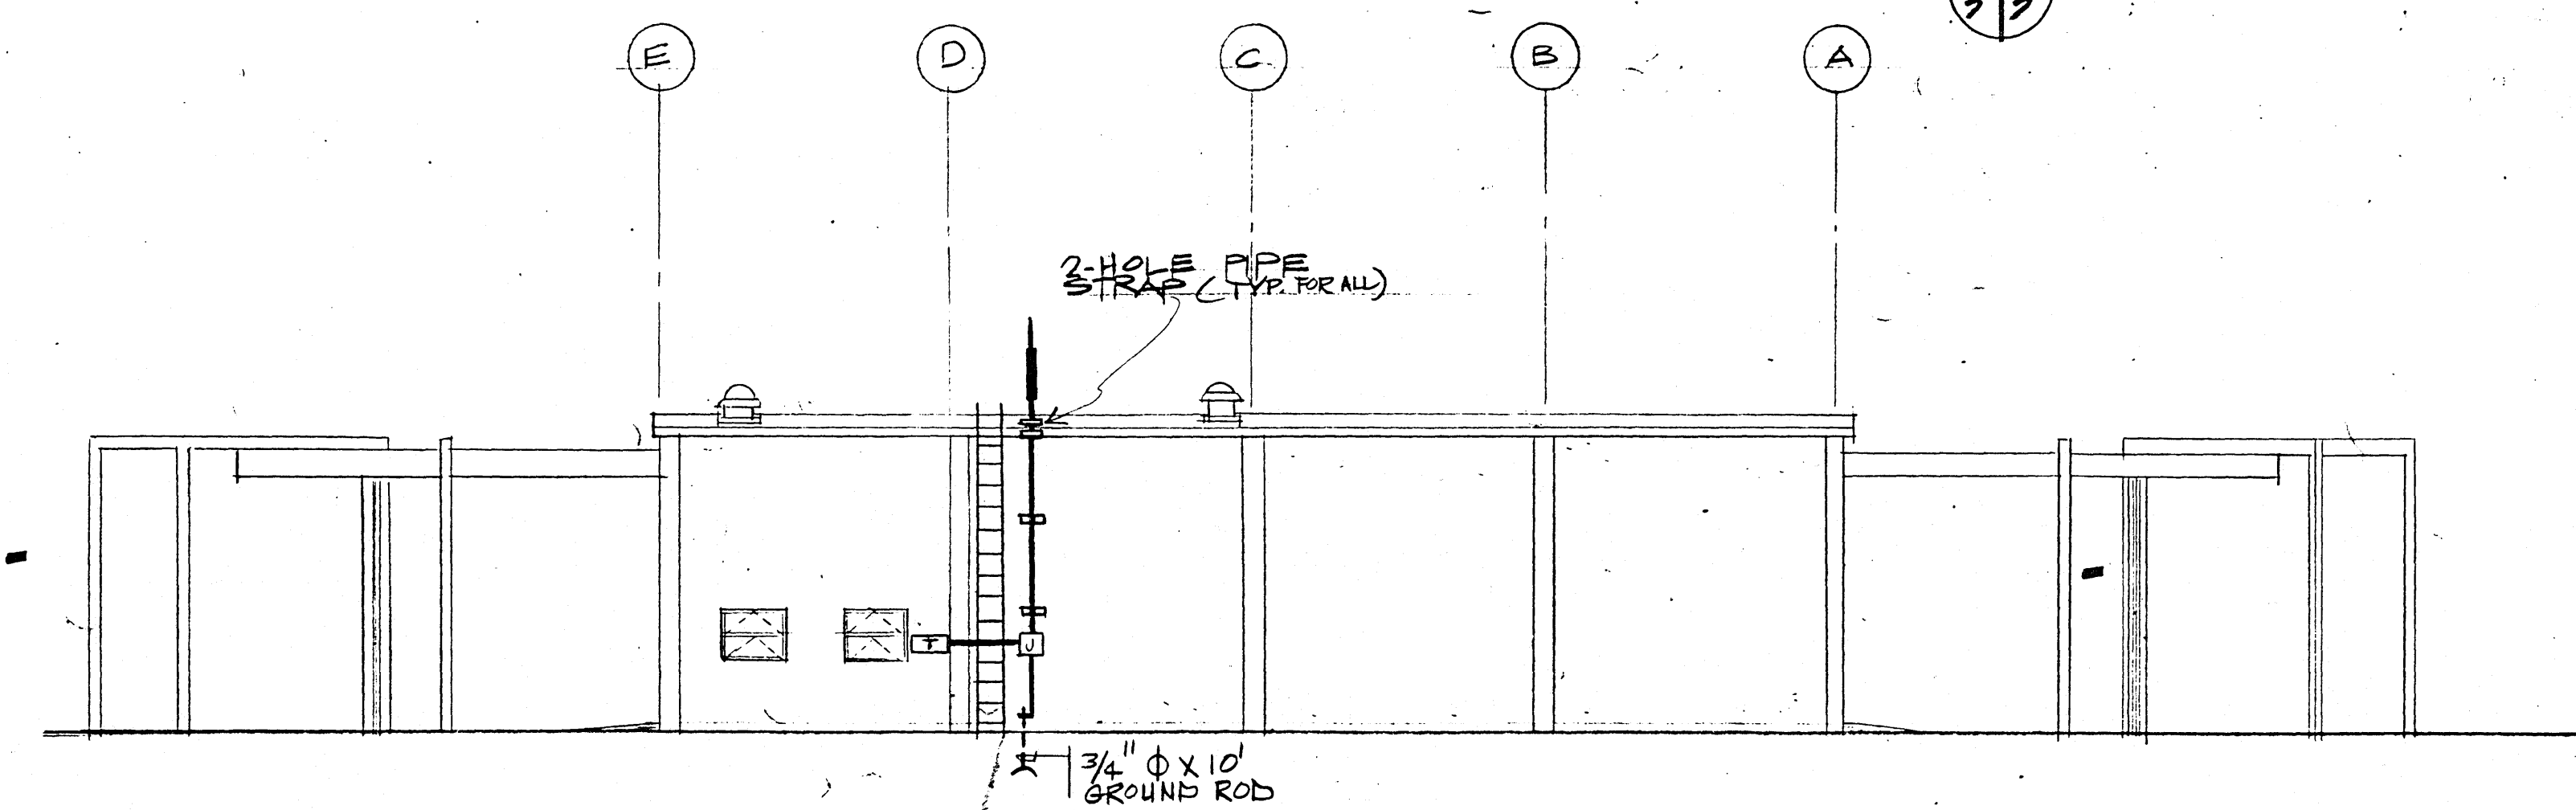

1 ELEVATION
SCALE: 3/32" = 1'-0"

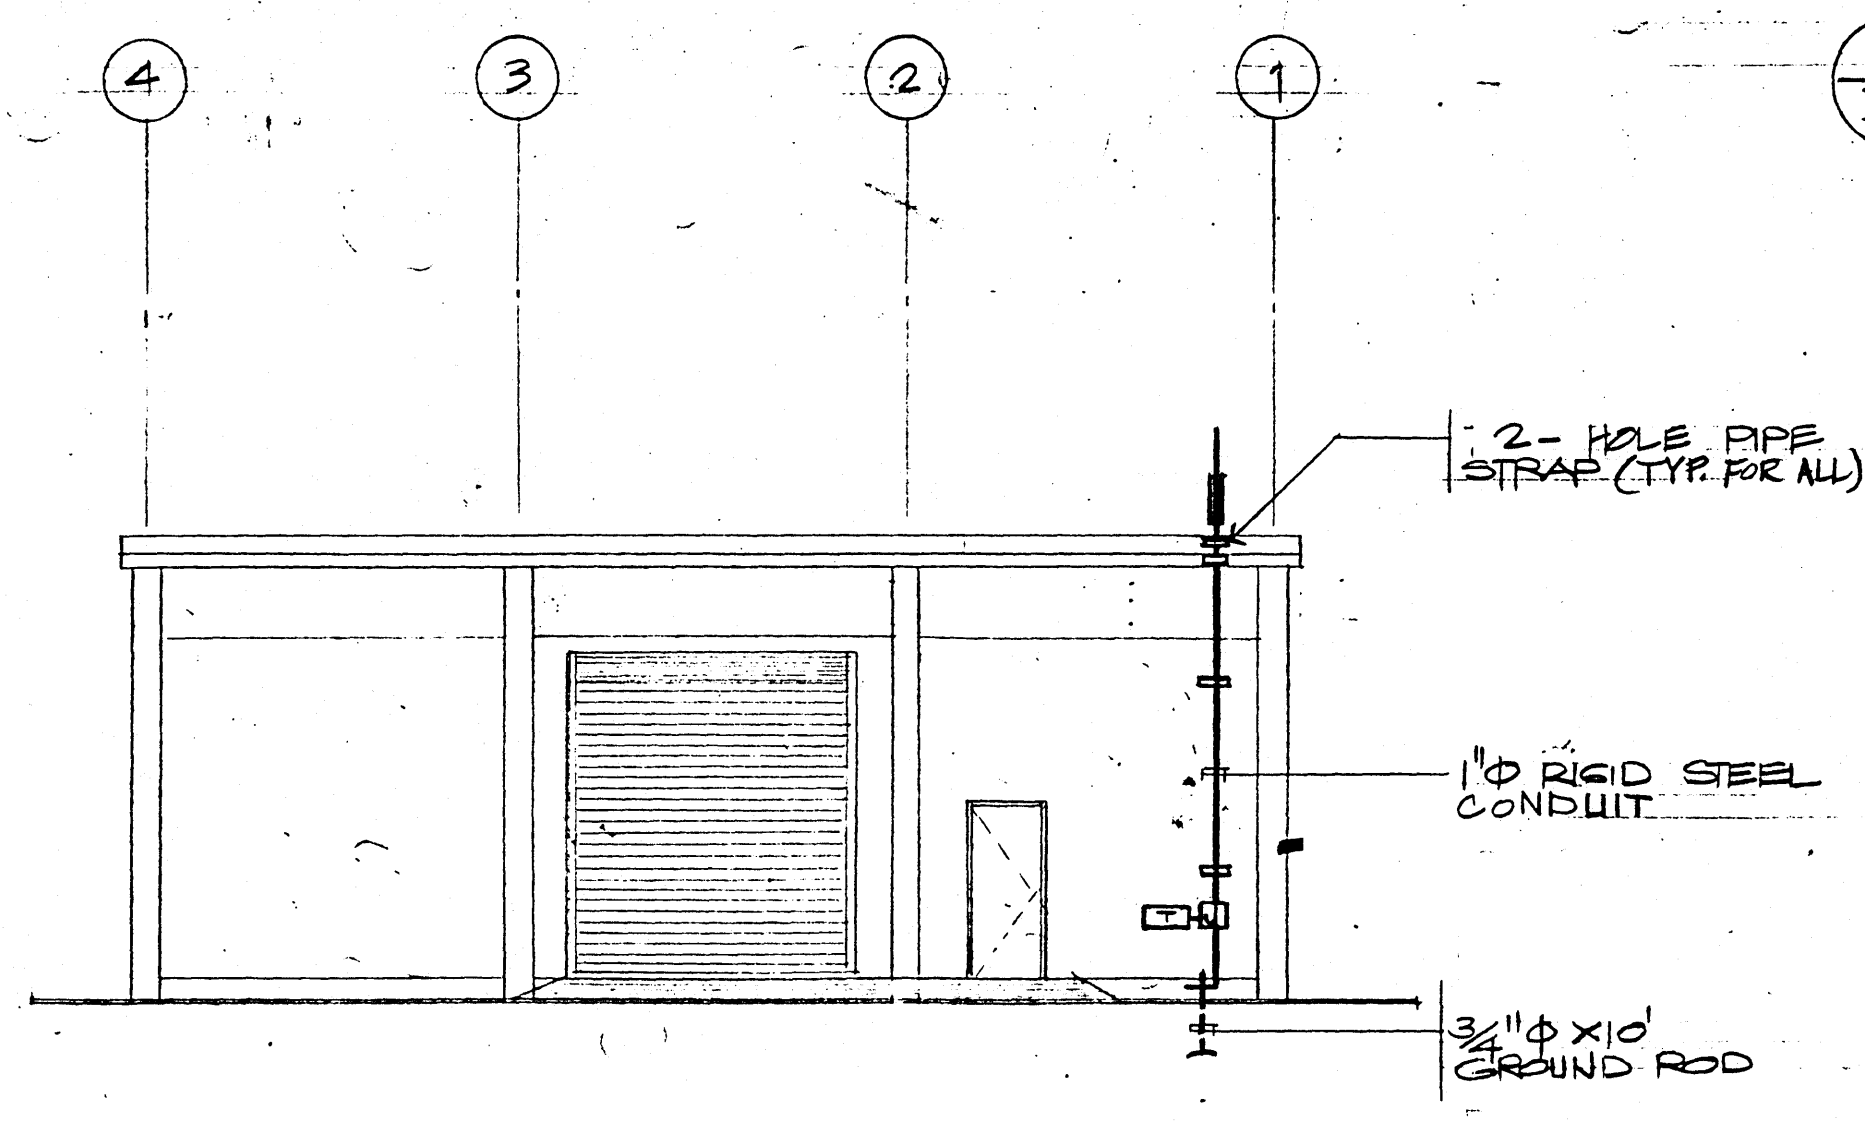

3 ELEVATION
SCALE: 1/8" = 1'-0"

- NOTES:**
- DEVICES ARE SHOWN IN SUGGESTED LOCATIONS. FINAL LAYOUT SHALL BE IN ACCORDANCE WITH ALL APPLICABLE CODES, MANUFACTURER'S RECOMMENDATIONS, SPECIFICATION SECTIONS 16722 AND 16723 AND EQUIPMENT LISTINGS. COORDINATE LOCATIONS WITH EXISTING OBSTRUCTION.
 - THE MINIMUM SIZE CONDUIT SHALL BE NO SMALLER THAN 3/4" IN DIAMETER.

DEPT OF THE NAVY PUBLIC WORKS CENTER GUAM, M.I.	NAVFAC DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND OFFICER IN CHARGE OF CONSTRUCTION NAVAL FACILITIES ENGINEERING COMMAND CONTRACTS, MARIANAS GUAM, M.I.
DESIGN: DR [Signature] CHK: VMG	FIRE ALARM PLAN BLDG. 22, BLDG. 23, ELEVATION, ZONE SCHEDULE & NOTES
DIV: DR [Signature] P.E. 22-89	WR NO: 80867
DEPT HEAD: [Signature] P.E. 8/1/89	REVIEWED BY: [Signature]
PL OFF	DIR, OIC ENGINEERING DIV. DATE
SIZE: F	APPROVED
CODE IDENT NO: 80091	OIC, FOR COMMANDER, NAVFAC. DATE
NAVFAC DRAWING NO: 7312.351	SCALE: AS SHOWN
CONSTR. CONTR. NO: 42766-83-C-2517	SPEC: 41-89-C-2517
SHEET 3 OF 7	

11/8/89
21